

BUILDING DEPARTMENT

CITIZEN'S SERVICE CENTER 201 SE 3rd ST. OCALA, FL 34471

CONTACT: Building Inspection Division Telephone (352) 629-8421

DRIVEWAY PERMIT APPLICATION

(Authority: City of Ocala Code of Ordinances Section 17-13 through Section 17-19)

STREET A	DDRESS WHERE DRIVEWAY IS TO BE BUILT:							
DATE OF A	APPLICATION:F	PERMIT APPLICATION FEE: \$						
NAME OF	DRIVEWAY PERMIT APPLICANT:							
COMPANY	/ NAME:	TELEPHONE NO.:						
EXISTING	CONNECTING STREET PAVEMENT SURFACE IS: $\[$	FLEXIBLE / ASPHALT RIGID / CONCRETE						
	CONNECTING STREET TYPE OF CURB IS:	STANDARD CURB AND GUTTER						
CONN	IECTING STREET HAS CURB PRESENT – NO DRIVE	WAY CULVERT REQUIRED						
CONN	CONNECTING STREET HAS NO CURB PRESENT - CULVERT REQUIRED (REFER TO DETAIL R-4 FOR MIN. SIZE)							
PROPOSE	ED DRIVEWAY IS FOR WHAT USE?	SIDENTIAL COMMERCIAL INDUSTRIAL SIDENTIAL COMMERCIAL INDUSTRIAL SID / CONCRETE FLEXIBLE / ASPHALT						
CONDITIO	NS: PERMITTEE AGREES THAT: ◆ DRIVEWAY WIL	LL BE LOCATED AND BUILT TO THE ATTACHED CIT						
STANDAR		EMENTS R-2 ACCESS DRIVE TYPICAL SECTION						
SUCH S WARNIN	SAFETY MEASURES, INCLUDING THE PLACEMENT A	DBSERVED DURING CONSTRUCTION AND TO TAKE AND DISPLAY OF CAUTION SIGNS, BARRICADES AND ND MAINTAIN THE DRIVEWAY PERMITTED HEREIN NINED AT ALL TIMES DURING CONSTRUCTION.						
PUBLIC		AND THAT THE PLACING OF FACILITIES WITHIN THE SHALL NOT OPERATE TO CREATE OR VEST ANY						
	AY CONSTRUCTION AND MAINTENANCE WILL NO HATS OF ANY PRIOR OR ABUTTING PROPERTY OWN	T INTERFERE WITH OR ENCROACH UPON ANY AND NERS.						
		EQUIREMENTS COULD RESULT IN CORRECTION OF K-CHARGES FOR ALL CITY LABOR AND MATERIALS.						
PUBLIC		ANCE OF ANY PRIVATE DRIVEWAY SURFACE WITHIN LL RESPONSIBILITY FROM DAMAGE OF ANY NATURE ENTS CONSTRUCTED UNDER THIS PERMIT.						
1. CON	TEE ALSO AGREES TO CALL AND ARRANGE FOR IN NCRETE CURB AND APRON FORMWORK - PRIOR TO ACEMENT AND COMPACTION OF DRIVEWAY BASE IN							
APPLICAN	IT'S / PERMITTEE'S SIGNATURE	INSPECTOR'S SIGNATURE						
FOR	BUILDING PERMIT NO	DRIVEWAY PERMIT NO.:						
CITY USE	REVIEWED BY:	DATE ISSUED:						
ONLY	PERMIT ISSUED BY:	INSPECTED BY:						




Driveway Standards Cover Sheet

Driveway Construction General Notes:

- 1. 6" thick 3,000 PSI fiber reinforced concrete or 6x6 wire mesh required for driveway approach, applies to all driveway section areas within the right of way and up to the property line. All concrete section areas to include fiber reinforced concrete or 6x6 wire mesh throughout the entire driveway area poured.
- Subgrade shall be compacted to a minimum of 95% modified proctor, any soil disturbed within 1 foot of the building structure perimeter shall be treated for termites.
- 3. A minimum driveway width of 10' feet is required. Maximum width of a residential driveway is 24' feet per driveway policy.
- 4. Provide a clean precise cut at driveway connection, tie into existing curb cut smoothly.
- 5. Driveway shall be constructed in a manner as to not cause an obstruction to the natural storm water surface flow. The existing drainage pattern shall not be altered without a professional signed and sealed engineered drainage and grading plan submitted and reviewed prior to completion of work.
- 6. See all attached Ocala Driveway Specification Standard Sheets R-1, R-2, R-3, and R-4, driveway flares shall be per the standard details provided.

Revised: 02/07/2019

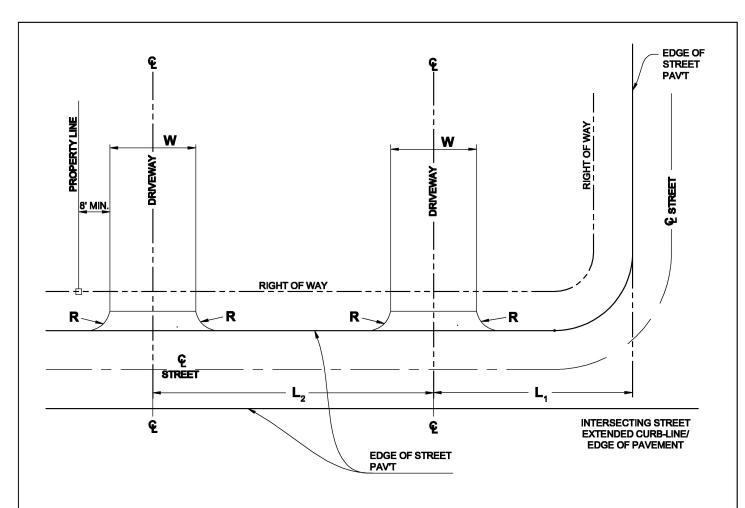

PLAN

ACCESS DRIVEWAY - MINIMUM CONNECTION SPACING									
BUILDING ZONE	USAGE CLASS	L ₁ TO STREET CORNER	L ₂ BETWEEN CONNECTIONS						
RESIDENTIAL AND HISTORIC DIST.	ALL APPLICATIONS	50 FEET	50 FEET						
INDUSTRIAL	ALL APPLICATIONS EXCEPT BELOW	200 FEET	200 FEET						
COMMERCIAL	LESS THAN 15,000 ADT ON THE CONNECTING STREET	150 FEET	150 FEET						
COMMERCIAL	15,000 ADT OR MORE ON THE CONNECTING STREET	200 FEET	200 FEET						
COMMERCIAL AND INDUSTRIAL	MORE THAN 65,000 BLDG. SQ. FT. OR MORE THAN 100 PEAK-HOUR TRIPS	300 FEET	300 FEET						

NOTES:


1. REFER TO DETAIL R-2 FOR "W" AND "R" VALUES.



CITY OF OCALA

STANDARD

ACCESS DRIVEWAY LAYOUT REQUIREMENTS

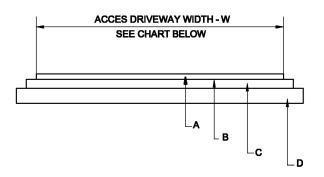

SECTION

MATERIALS OF CONSTRUCTION:

- A. SP 9.5 ASPHALT SURFACE COURSE.
- B. PRIME COAT, W/SAND APPLICATION, APPLIED AT A MINIMUM RATE OF 0.10 GALLONS PER SQUARE YARD.
- C. LIMEROCK BASE COURSE, LBR 100 MINIMUM, COMPACTED TO 98% MAXIMUM DENSITY PER AASHTO T-180.
- D. STABILIZED SUBGRADE TYPE 'B', LBR 40 MINIMUM, COMPACTED TO 98% MAXIMUM DENSITY, PER AASHTO T-180.

ACCESS DRIVEWAY - MINIMUM REQUIREMENTS WITHIN STREET RIGHT-OF-WAY											
	DRIVEWAY WIDTH - W			R		FLEXIBLE PAVEMENT SECTION COURSE THICKNESSES					
BUILDING	ONE-WAY TWO-WAY		O-WAY	CURB RADIUS		Α	С	D			
ZONE	MIN.	MAX.	MIN.	MAX.	MIN.	MAX.	ASPHALT SURFACE	LIMEROCK BASE	STABILIZED SUBGRADE (2)		
RESIDENTIAL (3)	10 FT.	14 FT.	20 FT.	24 FT.	5 FT.	20 FT. ⁽¹⁾	1 INCH	6 INCHES	8 INCHES		
INDUSTRIAL	14 FT.	18 FT.	24 FT.	40 FT.	30 FT.	60 FT.	2 INCHES	8 INCHES	12 INCHES		
COMMERCIAL	14 FT.	18 FT.	24 FT.	36 FT.	25 FT.	50 FT.	1-1/2 INCHES	8 INCHES	10 INCHES		
HISTORIC DIST.	9 FT.	12 FT.	16 FT.	24 FT.	4 FT.	25 FT. ⁽¹⁾	1 INCH	6 INCHES	8 INCHES		

- (1) OR FLARE SEE STANDARD DETAIL R-3 AND R-4.
- (2) STABILIZED SUBGRADE COURSE CAN BE REDUCED BY 2-INCHES FOR EVERY 1-INCH OF ADDITIONAL LIMEROCK BASE COURSE PROVIDED
- (3) RIGID (CONCRETE) PAVEMENT SECTION FOR RESIDENTIAL DRIVEWAYS SHALL BE 6-INCHES OF FIBER-REINFORCED 2500 PSI CONCRETE OVER A STABILIZED SUBGRADE.

NOTES

- MATERIALS AND METHODS OF CONSTRUCTION FOR THE ACCESS DRIVEWAY WITHIN THE STREET RIGHT OF WAY SHALL BE IN ACCORDANCE WITH THE FDOT 'STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION', CURRENT EDITION.
- 2. ALL INSUITABLE MATERIAL UNDER THE PROPOSED PAVEMENT, SUCH AS CLAY AND ROOTS, SHALL BE REMOVED TO A MINIMUM DEPTH OF 18 INCHES BELOW THE BOTTOM OF THE STABILIZED SUBGRADE. AN UNDERDRAIN SHALL BE INSTALLED THROUGH THE UNSUITABLE SECTION AREA.
- 3. INVERTED CROWN PAVEMENT SECTION MAY BE USED IF INCORPORATED INTO THE SITE STORM DRAINAGE DESIGN.
- 4. DROP (MIAMI) CURB MAY BE USED WHEN IT WILL ADEQUATELY CONTAIN SURFACE DRAINAGE AND NOT INTERFERE WITH CURB INLET STRUCTURES.
- 5. REFER TO CITY <u>DRIVEWAY POLICY</u> FOR MORE ACCESS DRIVEWAY REQUIREMENTS.





CITY OF OCALA

STANDARD


ACCESS DRIVEWAY
TYPICAL SECTION

R-2

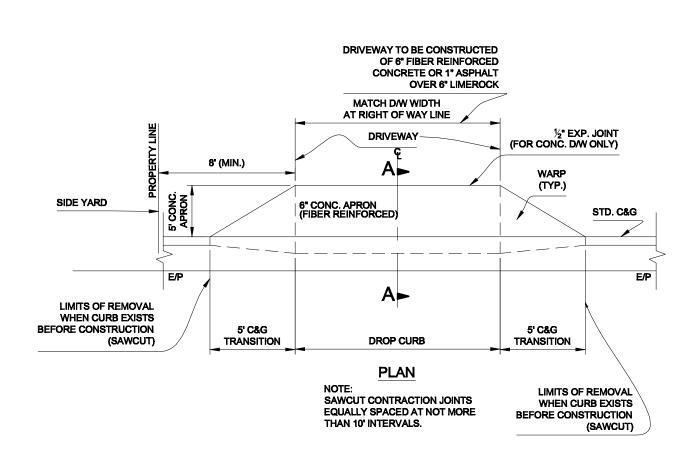



TURNOUT WITH SIDEWALK ADJACENT TO CURB



* THE 2% PORTION OF SIDEWALK BETWEEN DRIVEWAY MAY BE REDUCED TO 3' MIN. IN RESTRICTED CONDITIONS WHEN APPROVED BY THE ENGINEERING DEPARTMENT

TURNOUT WITH SIDEWALK AND UTILITY STRIP

SECTION

NOTES:

- 1. FOR RESIDENTIAL TURNOUTS WITH RADIAL RETURNS: MINIMUM 25' RADIUS, MAXIMUM 50' RADIUS. THE RETURN RADIUS SHALL NOT PASS BEYOND ADJOINING PROPERTY BOUNDARY LINE EXTENDED.
- 2. FOR COMMERCIAL & INDUSTRIAL TURNOUTS: REFER TO FDOT INDEX #515.





CITY OF OCALA

STANDARD

TYPICAL RESIDENTIAL DRIVEWAY DETAIL "A"

R-3

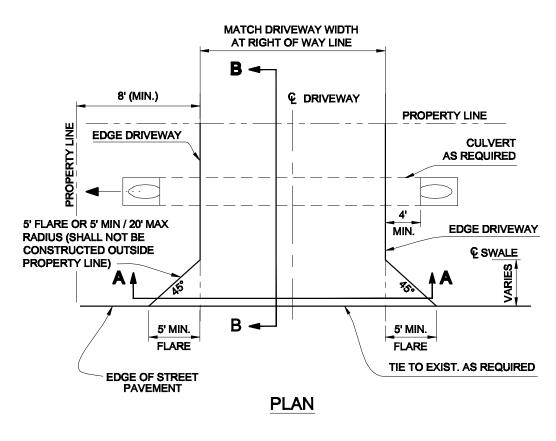

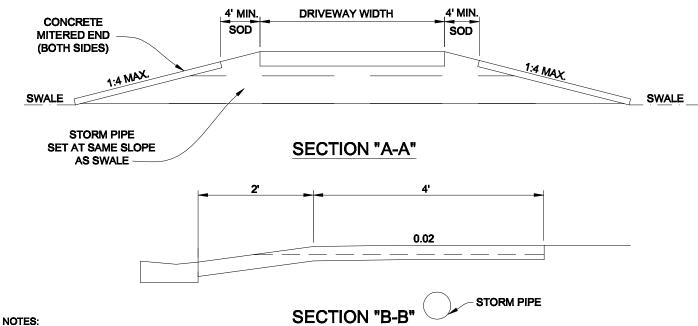

- TURNOUT WITH SIDEWALK ADJACENT TO CURB (6' IN WIDTH MINIMUM).
- 2. ASHPALT DRIVEWAY TO BE A MINIMUM OF 1" ASPHALT COVER OVER 6" MINIMUM LIMEROCK
- 3. CONCRETE DRIVEWAY TO BE A MINIMUM OF 6" FIBER-REINFORCED 2500 PSI CONCRETE



CITY OF OCALA

STANDARD

TYPICAL RESIDENTIAL DRIVEWAY DETAIL "B"

R-4

Version of JAN. 21, 2010